
## FIRE ALARM FOR ELEVATORS

UNDER NFPA 72 2002-2019

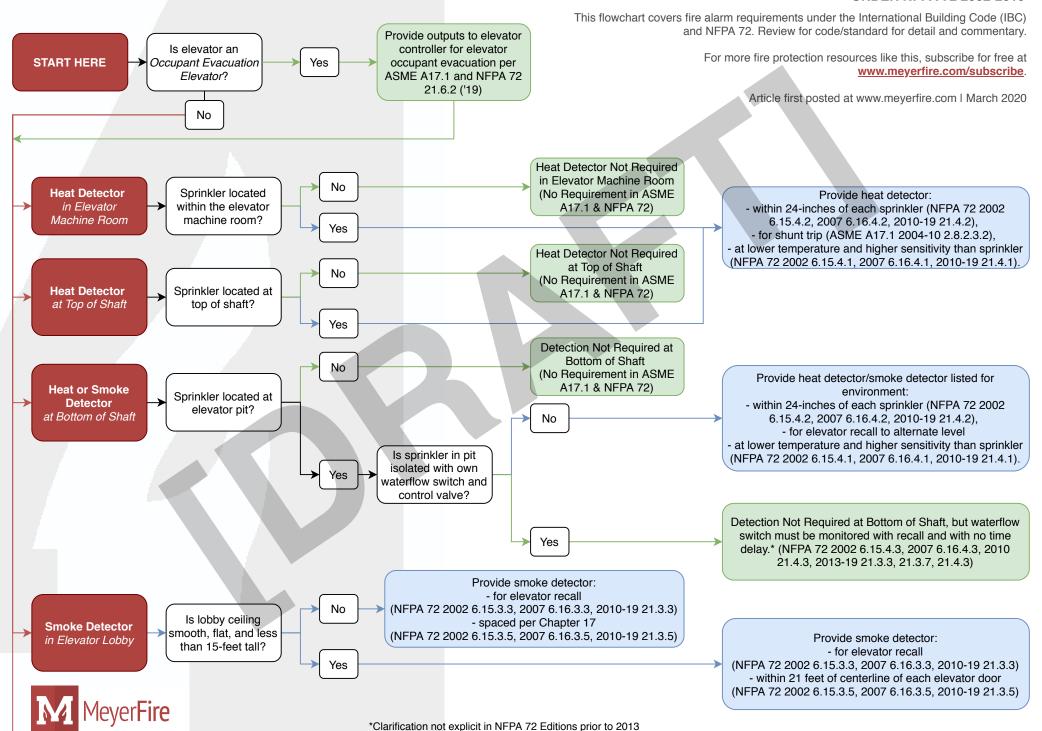

## **FIRE ALARM FOR ELEVATORS** UNDER NFPA 72 2002-2019 **Smoke Detector** Provide smoke detector: in Elevator Machine for elevator recall (NFPA 72 2016 21.3.3) Room Smoke detector not required at top of shaft (NFPA 72 2002 6.15.3.6, No 2007 6.16.3.6, 2010-19 Smoke relief 21.3.6) damper/equipment No Sprinkler located Provide smoke detector at top of shaft: provided? **Smoke Detector** Yes - for elevator recall (NFPA 72 2002 above lowest level of at Top of Shaft recall? No ► 6.15.3.7, 2007 6.16.3.7, 2010-19 21.3.7) - must be listed for environment Do ambient shaft (NFPA 72 2013-19 21.3.8) conditions prohibit Yes use of smoke detector? Provide heat detector or other detection device at top of shaft: Yes - for elevator recall (NFPA 72 2016 21.3.7, 21.3.9)