






ADVANTAGE OF FLOWING MORE WATER IN A FLOW TEST?

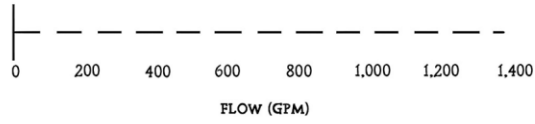


M

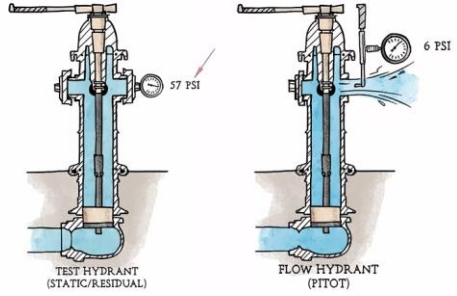

M

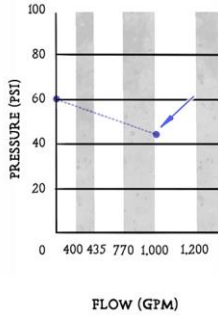


M

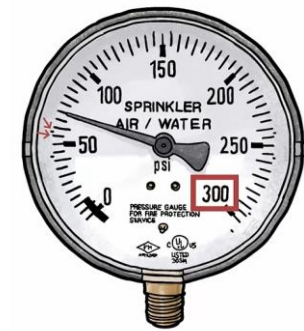

M

NOTES

A large grid of dotted lines for taking notes.

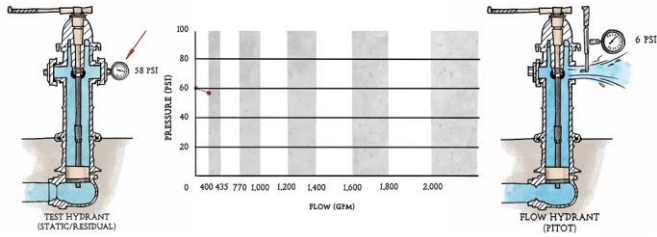

WHAT NFPA 291 RECOMMENDS:

- FLOW ENOUGH WATER THAT OUR RESIDUAL PRESSURE IS AT LEAST 25% BELOW THE STATIC
- FLOW RATE IS FOR FIREFIGHTING PURPOSES

WHY IS IT ADVANTAGEOUS TO FLOW MORE WATER DURING A FIRE HYDRANT FLOW TEST?

- GREATER CONFIDENCE IN THE DATA
- GIVES OUR RESULTS MORE TOLERANCE



NOTES

Grid of dots for taking notes.