


FIRE SPRINKLERS FOR ELECTRICAL ROOMS

UNDER IBC/IFC 2000-2021 & NFPA 13 2002-2022 EDITIONS

This flowchart covers fire sprinkler requirements specifically for electrical rooms.
For more fire protection resources like this, subscribe for free at www.meyerfire.com/subscribe.

Article first posted at www.meyerfire.com | August 2022

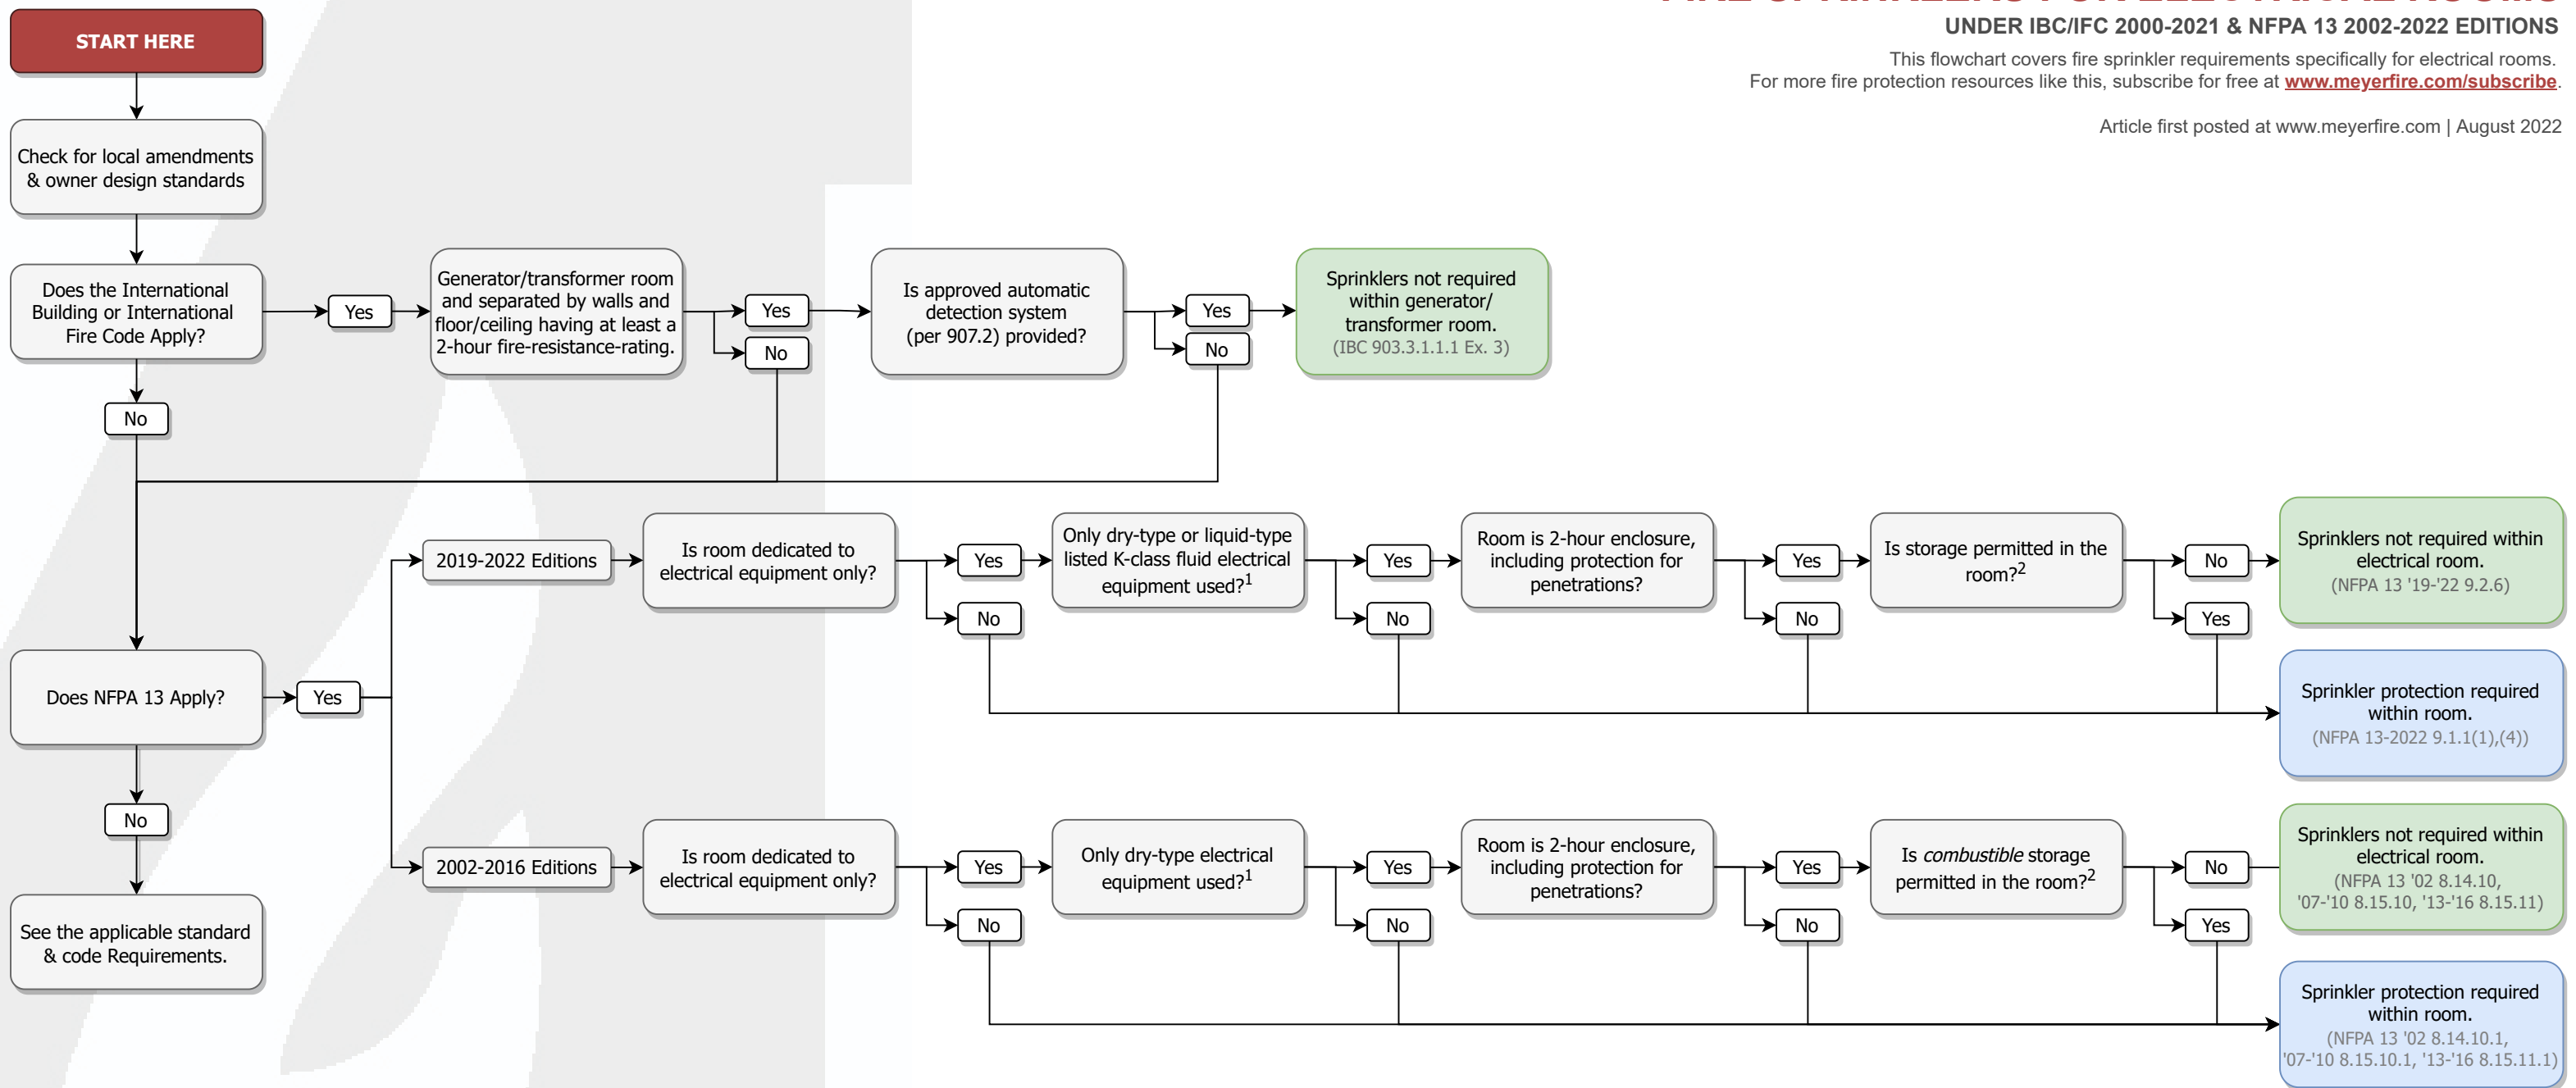

¹ The 2019 Edition of NFPA 13 added listed K-class fluid electrical equipment to acceptable types

² The 2019 Edition of NFPA 13 clarified that no storage is permitted in electrical rooms, to address the concern that noncombustible storage in the room could lead to combustibles as well.

